


Z44T-10-DN50-300

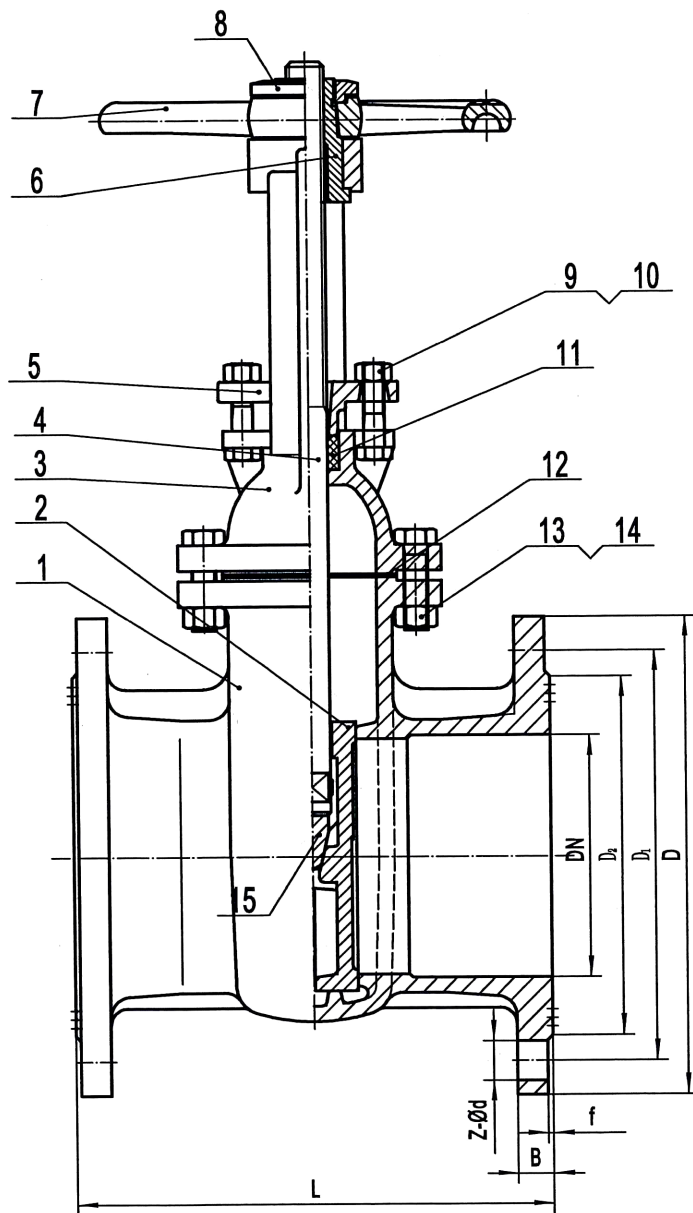

TECHINICAL REQUIREMENT

1.TEST ACCORDING TO GB/T13927.

SPECIFICATION

DN	L	D	D ₁	D ₂	B-f	Z-Ød
50	180±2	160	125	100	17-2	4-Ø18
80	210±2	195	160	135	19-2	4-Ø18
✓ 100	230±2	215	180	155	19-2	8-Ø18
✓ 150	280±2	280	240	210	21-3	8-Ø23
✓ 200	330±2	340	295	265	23-3	8-Ø23
✓ 250	450±3	395	350	320	26-3	12-Ø23
✓ 300	500±3	445	400	368	26-3	12-Ø23

DN	DN50-300
PN MPa	1.0
TEMPERATURE℃	-10~200
TEST PRESSURE MPa	SEAL(WATER) 1.1
	SHELL(WATER) 1.5
	BACK SEAT NO
MEDIUM	WATER,STEAM

15	WEDGE	CAST IRON			
14	BOLT	35# STEEL			
13	NUT	25# STEEL			
12	BONNET GASKET	ASBESTOS RUBBER PLATE (XB200)			
11	PACKING	FLEXIBLE GRAPHITE			
10	BOLT	35# STEEL			
9	NUT	25# STEEL			
8	LOCK NUT	CAST IRON			
7	HANDWHEEL	CAST IRON			
6	STEM NUT	CAST IRON			
5	PACKING GLAND	CAST IRON			
4	STEM	Q235 STEEL			
3	BONNET	CAST IRON			
2	DISC	CAST IRON			
1	BODY	CAST IRON			
NO	CODE	NAME	QTY	MATERIAL	REMARK

YUANDA VALVE GROUP
CO., LTD.

GATE VALVE

Z44T-10 DN50-300



204 607 1041111111