


207 45

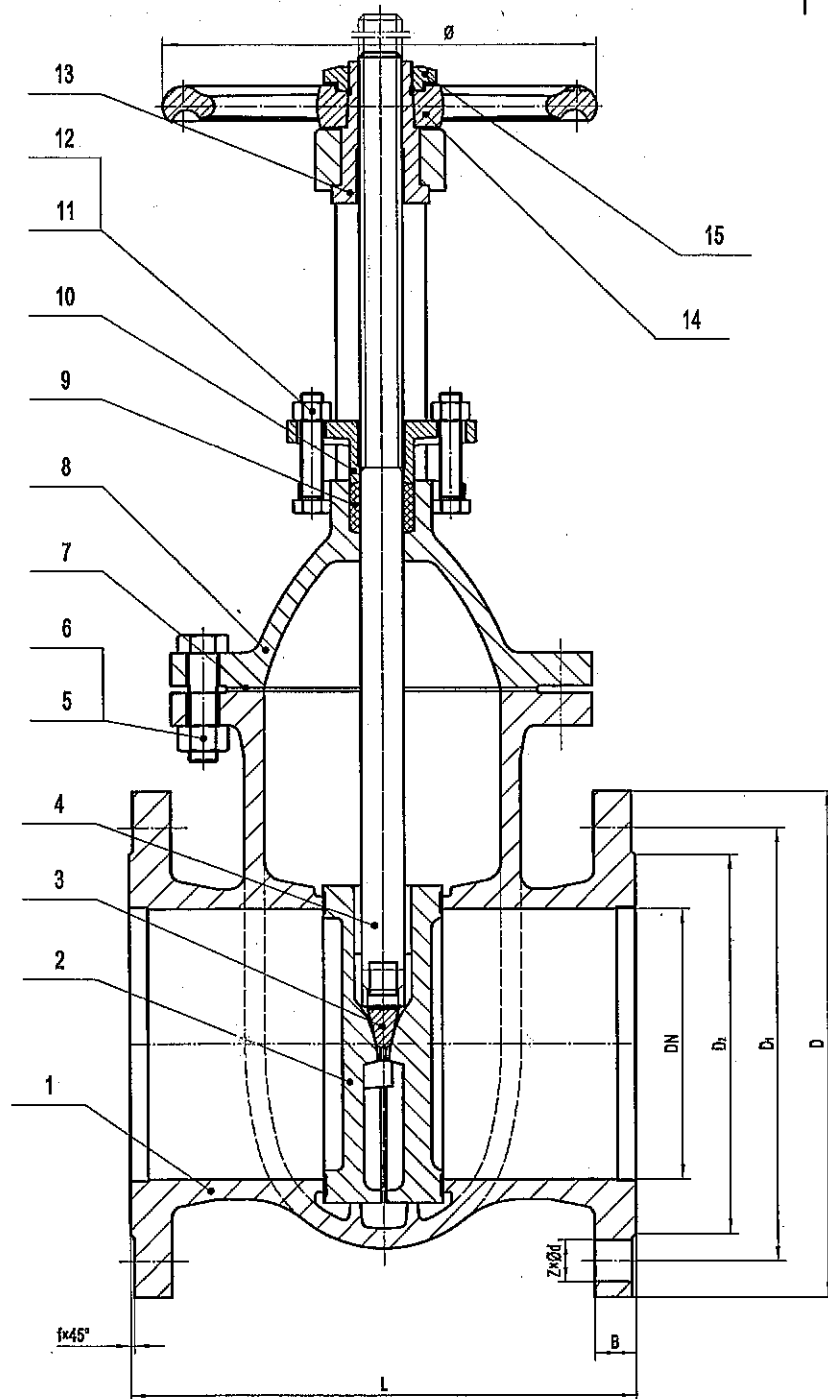

TECHNICAL REQUIREMENT

1. PRESSURE TEST SHOULD ACCORDING WITH
GB/T13927

SPECIFICATION

DN		DN50-400	
NOMINAL PRESSURE		1.0 MPa	
SUITABLE TEMP		COPPER SEAL FACE	-10~200℃
TEST PRESSURE MPa		SHELL (WATER)	1.5
		SEAL (WATER)	1.1
		BACK SEAL	1
MEDIUM		COPPER SEAL FACE	STEAM/WATER

15	NUT	CAST IRON
14	HANDWHEEL	CAST IRON
13	STEM NUT	CAST IRON
12	BOLT	35#STEEL
11	NUT	25#STEEL
10	GLAND	CAST IRON
9	GRAPHITE PACKING	EXPENDED GRAPHITE
8	BONNET	CAST IRON
7	GASKET	ASBESTOS RUBBER PLATE (X3210)
6	BOLT	35#STEEL
5	NUT	25#STEEL
4	STEM	Q235/2Cr13
3	UPPER BEAM	QT450-10
2	DISC	CAST IRON
1	BODY	CAST IRON

NO.	CODE	NAME	QTY	MATERIAL	1 PC TOTAL WEIGHT	NOTE
-----	------	------	-----	----------	-------------------	------

YUANDA VALVE GROUP
CO.,LTD.
RISING PARALLEL
GATE VALVE (HEAVY)
Z44T-10
DN65/125/350/400