


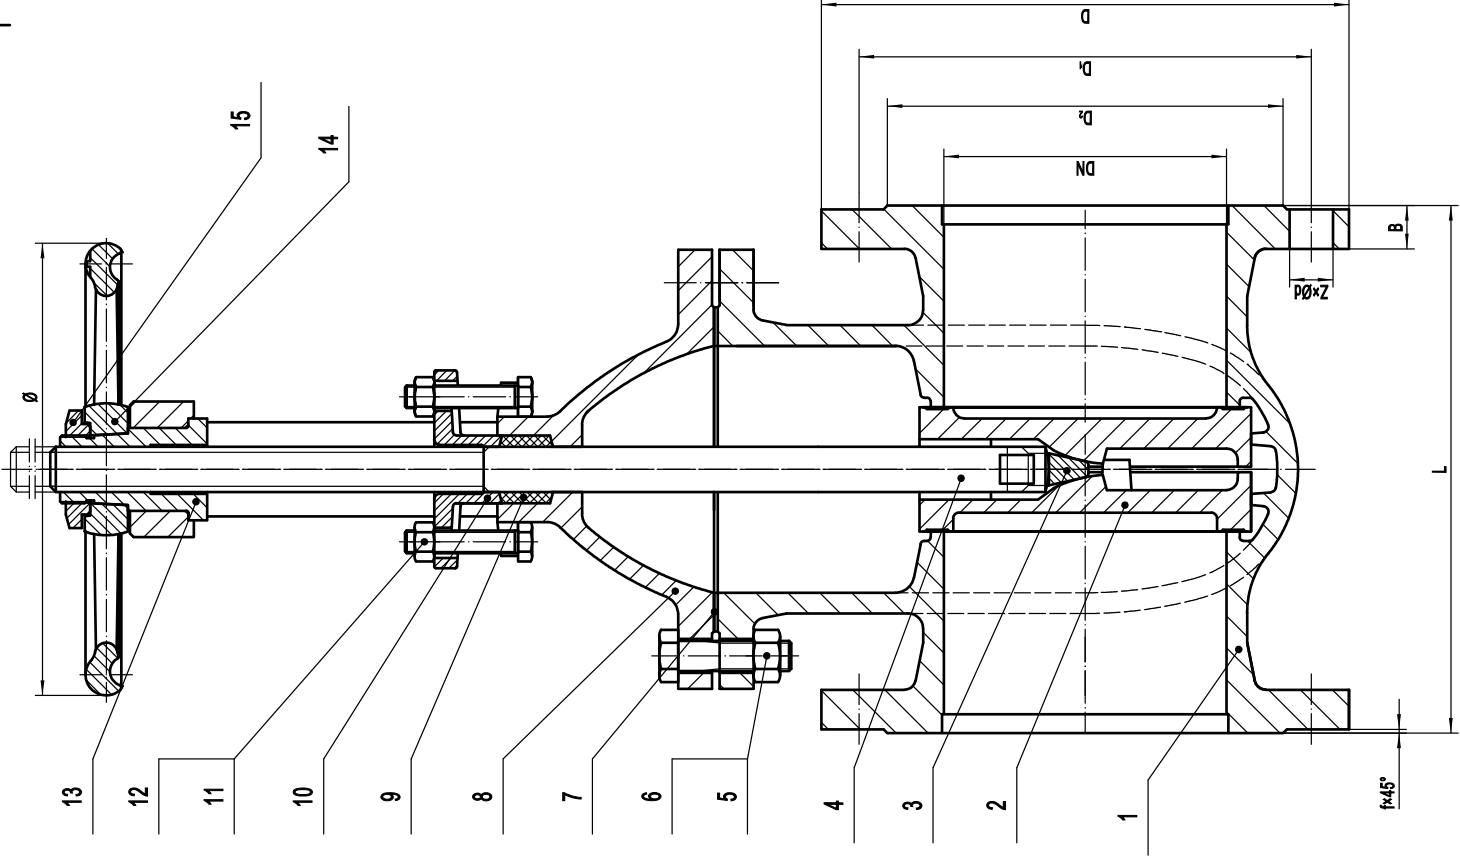

TECHNICAL REQUIREMENT

1.PRESSURE TEST SHOULD ACCORDING WITH
GB/T13927

SPECIFICATION

DN	L	D	D1	D2	B-F	Z-9d	Ø	DN50-400			
								NOMINAL PRESSURE	1.0 MPa		
										SUITABLE TEMP	COPPER SEAL FACE
										-10~200℃	-10~200℃
										TEST PRESSURE	SHELL (WATER)
MPa	SEAL (WATER)	1.5	1.1								
								BACK SEAL	1		
								COPPER SEAL FACE	STEAM/WATER		
15					NUT			CAST IRON			
14					HANDWHEEL			CAST IRON			
13					STEM NUT			CAST IRON			
12					BOLT			35#STEEL			
11					NUT			25#STEEL			
10					GLAND			CAST IRON			
9					GRAPHITE PACKING			EXPENDED GRAPHITE			
8					BONNET			CAST IRON			
7					GASKET			ASBESTOS RUBBER PLATE (200W)			
6					BOLT			35#STEEL			
5					NUT			25#STEEL			
4					STEM			Q235/2C13			
3					UPPER BEAM			QT450-10			
2					DISC			CAST IRON			
1					BODY			CAST IRON			
NO.	CODE	NAME	QTY	MATERIAL	1 PC TOTAL		NOTE				
					WEIGHT						

YUANDA VALVE GROUP	
CO.,LTD.	
RISING PARALLEL	
GATE VALVE (HEAVY)	
Z44T-10	
DN65/125/350/400	