


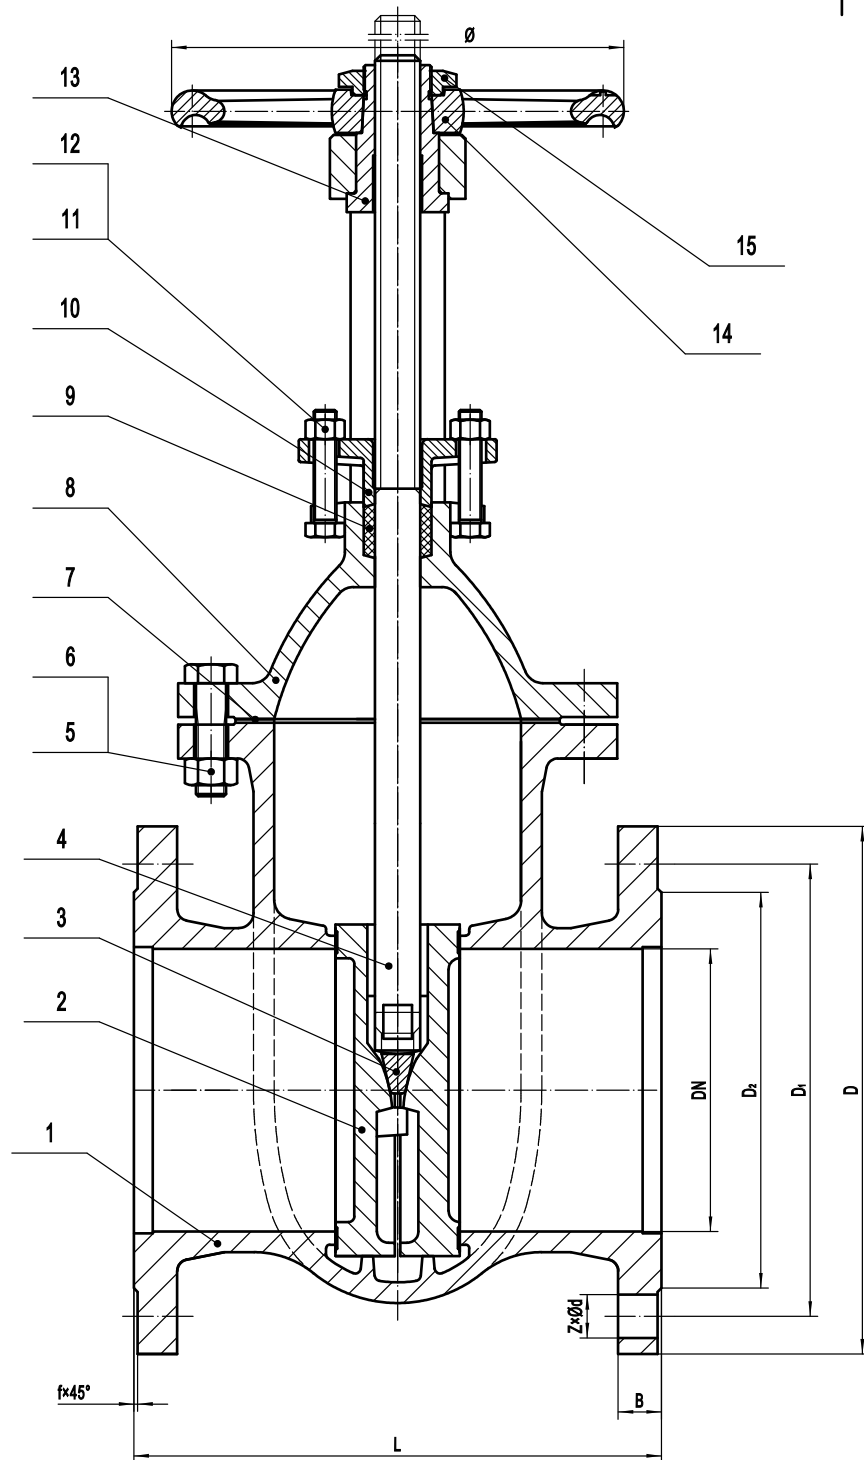

TECHNICAL REQUIREMENT

1.PRESSURE TEST SHOULD ACCORDING WITH
GB/T13927

SPECIFICATION

DN		DN50-400		
NORMINAL PRESSURE		1.0 MPa		
SUITABLE TEMP		COPPER SEAL FACE	-10~200℃	
TEST PRESSURE MPa		SHELL (WATER)	1.5	
		SEAL (WATER)	1.1	
		BACK SEAL	\	
MEDIUM		COPPER SEAL FACE	STEAM/WATER	

DN	L	D	D1	D2	B-f	Z-Ød	Ø
65	195±2	180	145	120	20-3	4-Ø18	180
125	255±2	245	210	185	24-3	8-Ø18	240
350	550±3	500	460	428	30-4	16-Ø23	400
400	600±3	565	515	482	32-4	16-Ø25	500

15		NUT		CAST IRON			
14		HANDWHEEL		CAST IRON			
13		STEM NUT		CAST IRON			
12		BOLT		35#STEEL			
11		NUT		25#STEEL			
10		GLAND		CAST IRON			
9		GRAPHITE PACKING		EXPENDED GRAPHITE			
8		BONNET		CAST IRON			
7		GASKET		ASBESTOS RUBBER PLATE (XB200)			
6		BOLT		35#STEEL			
5		NUT		25#STEEL			
4		STEM		Q235/2Cr13			
3		UPPER BEAM		QT450-10			
2		DISC		CAST IRON			
1		BODY		CAST IRON			

NO.	CODE	NAME	QTY	MATERIAL	1 PC TOTAL	NOTE
					WEIGHT	

YUANDA VALVE GROUP
CO.,LTD.
RISING PARALLEL
GATE VALVE (HEAVY)
Z44T-10
DN65/125/350/400